


- NOTES:
- 1) SEE CONCRETE STANDARDS PAGE FOR ADDITIONAL REQUIREMENTS.
 - 2) ALL REINFORCING STEEL SHALL BE #4 REBAR.
 - 3) REINFORCING BARS SHALL BE CONTINUOUS THROUGH GUTTER RADII.
 - 4) THE LONGITUDINAL BARS SHALL BE 12" O.C. THE TRANSVERSE BARS SHALL BE 18" O.C. THE SPLICED BARS SHALL HAVE A MINIMUM LAP OF 12".
 - 5) CONCRETE SHALL BE VIBRATED WHILE BEING PLACED.
 - 6) GUTTER FLOW LINE SHALL BE CENTERED IN GUTTER AND HAVE A 1" SLOPE IN 18" FROM GUTTER EDGE TO FLOW LINE.
 - 7) STREET VALLEY GUTTER TO BE APPROVED BY CITY ENGINEER.
 - 8) EXISTING AC SHALL BE REMOVED/REPLACED ALONG ENTIRE GUTTER SECTION TO A MIN. 18" WIDTH THAT PROVIDES FOR A 6% CROSS SLOPE, OR AS DIRECTED BY ENGINEER.
 - 9) CONCRETE SHALL NOT BE PLACED UNTIL FORMS HAVE BEEN INSPECTED AND APPROVED BY ENGINEER.
 - 10) AN ENCROACHMENT PERMIT IS REQUIRED PRIOR TO STARTING ANY WORK.

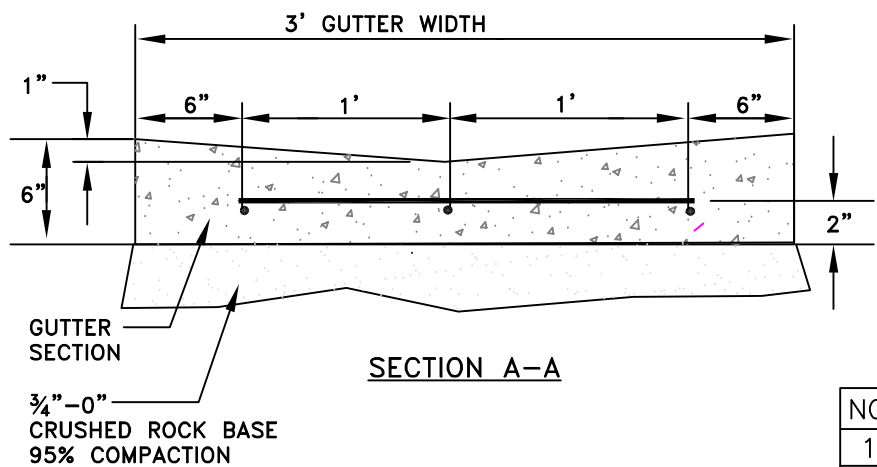

SECTION A-A

NO.	DATE	INITIAL	REVISIONS	CITY OF GRANTS PASS ENGINEERING DIVISION	
1	6-97	FMS	UPDATE	STREET VALLEY GUTTER	
2	12/04	FMS	STD DWG UPDATE		
3	10/09	GLV	STD DWG UPDATE		
DESIGN: STAFF		DRAWN: SLN		APPROVED: DAP	SCALE: NONE
					DWG. NO. 108