


3" IRRIGATION CHASE
 3" PVC SLEEVE TO WATER METER BOX. SEE GPSD #203 FOR METER DETAILS. CONTRACTION JOINT OVER PIPE

NOTES:

- 1) SEE CONCRETE STANDARDS PAGE FOR ADDITIONAL REQUIREMENTS.
- 2) SIDEWALK SECTION SHALL BE A MINIMUM OF 4" THICK.
- 3) SURFACE SHALL NOT VARY MORE THAN 1/4" UNDER A 12' STRAIGHTEDGE.
- 4) THE CROSS SLOPE OF ANY WALKING SURFACE SHALL NOT EXCEED 2%. PROVIDE CONTRACTION JOINTS AT 15' INTERVALS.
- 5) PROVIDE 3" PVC PIPE SLEEVE FROM BACK OF EXISTING METER BOXES TO BACK EDGE OF SIDEWALK, WHERE PROPERTY SERVICE LINE IS NOT INSTALLED.
- 6) PROVIDE 3" PVC PIPE FOR WEEP HOLE DRAINAGE THROUGH APPROACH & CURB AS DIRECTED BY ENGINEER.
- 7) PROVIDE 3" IRRIGATION CHASE FROM BACK OF SIDEWALK TO PLANTER STRIP. STAKE EACH END OF CHASE UNTIL CONNECTED TO IRRIGATION.
- 8) EXISTING AC SHALL BE REMOVED/REPLACED ALONG ENTIRE CURB SECTION TO A MIN. 18" WIDTH, OR WIDTH THAT PROVIDES FOR A 6% OR LESS CROSS-SLOPE, OR AS DIRECTED BY THE CITY ENGINEER.
- 9) CONCRETE SHALL NOT BE PLACED UNTIL FORMS HAVE BEEN INSPECTED AND APPROVED BY ENGINEER.
- 10) AN ENCROACHMENT PERMIT IS REQUIRED PRIOR TO STARTING ANY WORK.

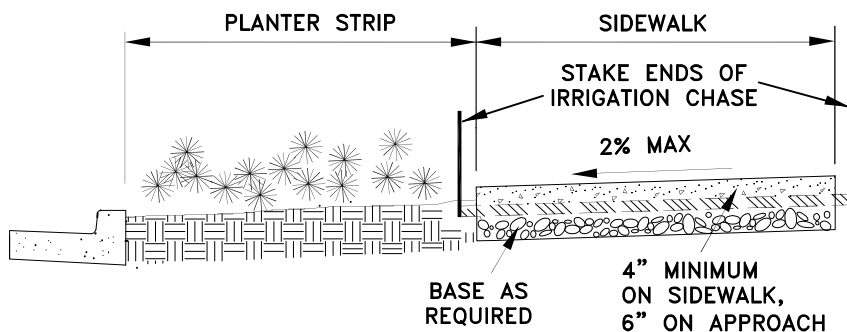

				CITY OF GRANTS PASS ENGINEERING DIVISION	
NO.	DATE	INITIAL	REVISIONS	SIDEWALK W/ PLANTER STRIP	
2	6-97	FMS	UPDATE		
3	10-04	FMS	STD DWG UPDATE		
4	10-09	GLV	STD DWG UPDATE		
DESIGN: STAFF		DRAWN: GLV	APPROVED: RJS	SCALE: NONE	DWG. NO. 106