


NOTES


1. WATER METER SHALL BE PROVIDED & INSTALLED BY THE CITY AFTER PAYMENT OF ALL CONNECTION FEES HAVE BEEN PAID BY OWNER OR CONTRACTOR
2. PLACE A 3" PVC SLEEVE PROPERLY ALIGNED WITH CURB STOP, AND FLUSH WITH INSIDE OF METER BOX. DO NOT CUT BOX.
3. METER BOX TO BE FLUSH WITH FINISHED GRADE.
4. TRAFFIC LID W/ PEEP REQUIRED ON ALL WATER METER BOXES WHEN INSTALLED IN DRIVEWAY APPROACHES, INCLUDING THE FLARES.
5. TOP OF CURB STOP SHALL BE 8" TO 10" BELOW TOP OF METER BOX.
6. CURB STOP SHALL BE INSTALLED UPRIGHT & INLINE WITH SLEEVE FOR CUSTOMER LINE
7. TOP OF CURB TO BE STAMPED WITH THE LETTER "W". (NEW CURB ONLY)
8. CITY TO TAP LIVE MAINS.
9. NO SERVICE SHALL BE INSTALLED CLOSER THAN 5 FEET TO A FRONT PROPERTY CORNER.
10. ALL SERVICES TO BE INSTALLED PERPENDICULAR TO MAIN.
11. NO PRIVATE VALVES OR APPURTENANCES IN SIDEWALK.

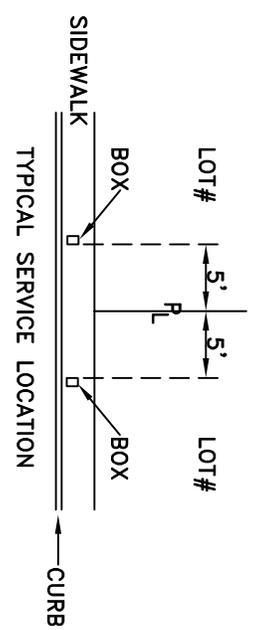

BROOK'S NO. 37 WATER METER BOX (WITH LID WITH HINGED PEEP) OR APPROVED EQUAL.

NOTE: NO PLASTIC BOXES, LIDS, LINERS OR COVERS IN APPROACHES, SIDEWALK OR RIGH-OF-WAY

1" (IPS) POLYETHYLENE GLASS 200 PSI PE 3408 CONFORMING TO AWWA C901 WITH AN SIDR OF 7.

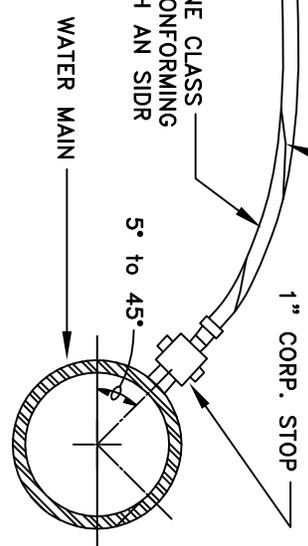

CORPORATION STOP
 1" CC THD x 1" IPS PACK JOINT.
 APPROVED BRANDS - MUELLER, FORD, McDONALD
 OR 1" CC THD x 1" MALE CTS WITH A 1" FEMALE CTS x MUELLER INSTATITE® ADAPTER. APPROVED BRANDS FOR CORP. STOP - MUELLER, FORD, McDONALD.
 APPROVED BRAND FOR ADAPTER - MUELLER ONLY.

ANGLE CURB STOP
 1" IPS PE PACK JOINT x 1" METER SWIVEL NUT.
 APPROVED BRANDS - MUELLER, FORD, McDONALD
 OR, 1" MUELLER IPS INSTATITE® x 1" METER SWIVEL NUT.
 APPROVED BRAND - MUELLER ONLY. PART # H-14266-1

NO.	DATE	INITIAL	REVISIONS	CITY OF GRANTS PASS ENGINEERING DIVISION	
5	2/05	FMS	WATER STD. UPDATE	1" WATER SERVICE	
6	10/09	GLV	WATER STD. UPDATE		
7	11/10	GLV	ADD SINGLE CHECK		
DESIGN: STAFF				SCALE: NONE	DWG. NO. 203
DRAWN: SIN				APPROVED: RJS	