

**\*\*Note: no plastic boxes, lids, liners or covers in approaches, sidewalk or right-of-way\*\***

**General Notes**


1. Water meter shall be provided & installed by the City after payment of all connection fees have been paid by owner or contractor.
2. City to tap live mains.
3. No service shall be installed closer than 5 feet to a front property corner.
4. Place a 2 1/2"-3" PVC sleeve properly aligned with curb stop, and flush with inside of meter box. Do not cut box.
5. All services to be installed perpendicular to water main.
6. Curb stop shall be installed upright & inline with sleeve for customer line.
7. Top of curb stop shall be 8" to 10" below top of meter box.
8. Plumbing shall be centered in water meter box.
9. Meter box and water service must be perpendicular to curb.
10. Meter box to be flush with finished grade.
11. No notched or cut meter boxes.
12. Min. 6" new concrete on all sides.
13. Multiple meter boxes require 6" min. separation between boxes.
14. Traffic rated lid required on all water meter boxes when installed in driveway approaches, including the flares (B12G Christy).
15. Meter lids shall fit properly. Meter and lid must be by same manufacturer.
16. No private valves or appurtenances in sidewalk.
17. Multiple meter boxes shall be aligned wherever possible.

**Corporation stop**

1" CC THD x 1" IPS pack joint.  
 Approved brands - Mueller, Ford, Mcdonald  
 or 1" CC THD x 1" male CTS with a 1" female CTS x Mueller instatite® adapter. Approved brands for corp. stop - Mueller, Ford, Mcdonald.  
 Approved brand for adapter - Mueller only.

**Angle curb stop**

1" IPS PE pack joint x 1" meter swivel nut.  
 Approved brands - Mueller, Ford, Mcdonald  
 or, 1" Mueller IPS Instatite® x 1" meter swivel nut.  
 Approved brand - Mueller only. Part # H-14266-1

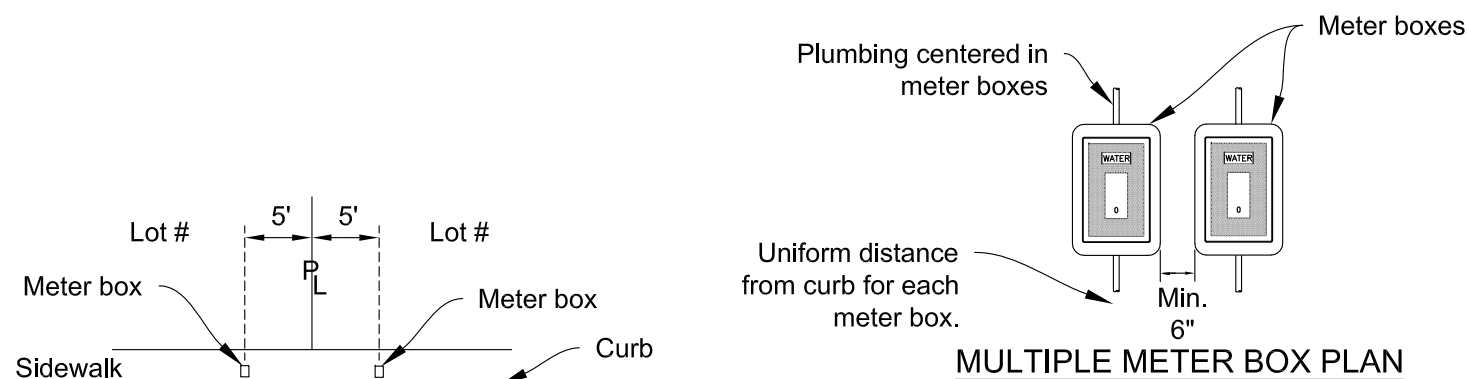

**TYPICAL SERVICE LOCATION**

The selection and use of this standard drawing, while designed in accordance with generally accepted engineering principles and practices, is the sole responsibility of the user.

Designed By:	STAFF
Drawn By:	KJD
Checked By:	MPT
Approved:	JMC

No.	Date	Revisions	App. By
1	12/18	Remove Curb Stamp	JMC



**CITY OF GRANTS PASS**  
 101 Northwest 'A' Street  
 Grants Pass, OR 97526  
 (541) 450-6060 ph (541) 476-9218 fax

**1" WATER SERVICE CONNECTION DETAIL**